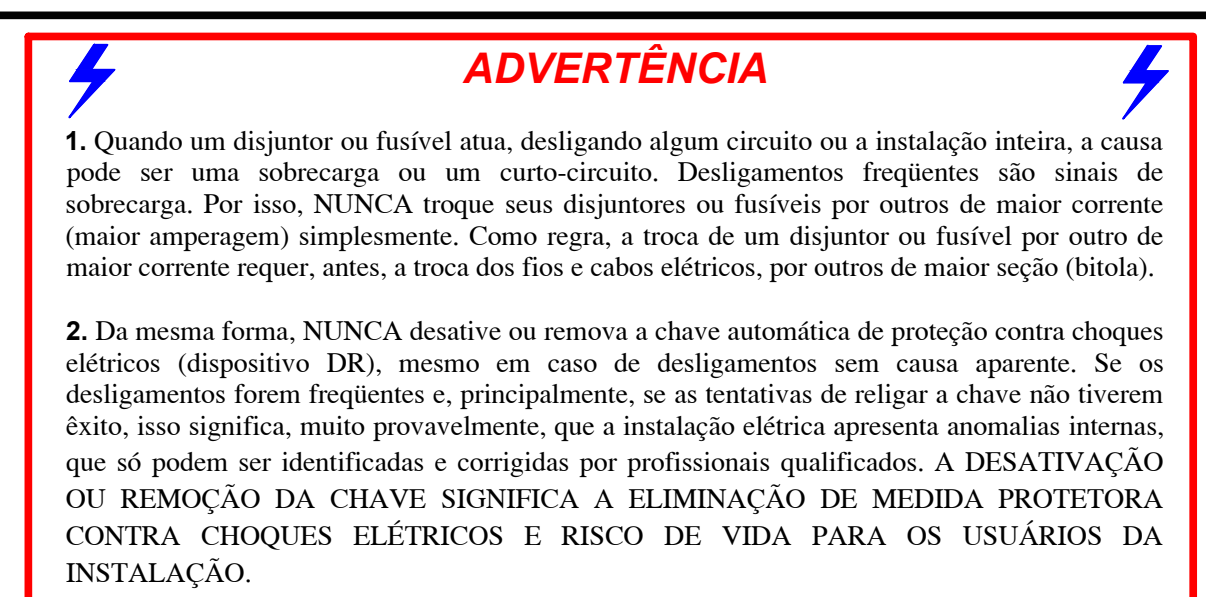

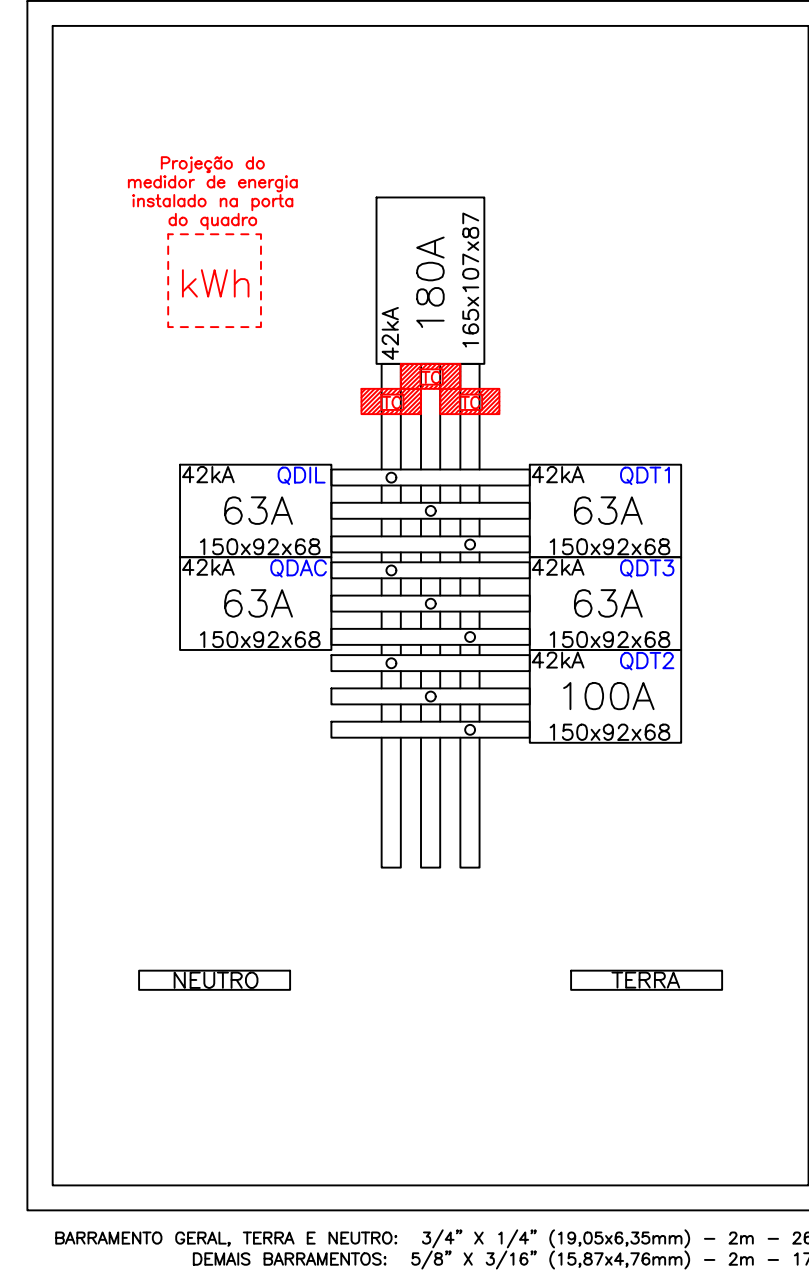
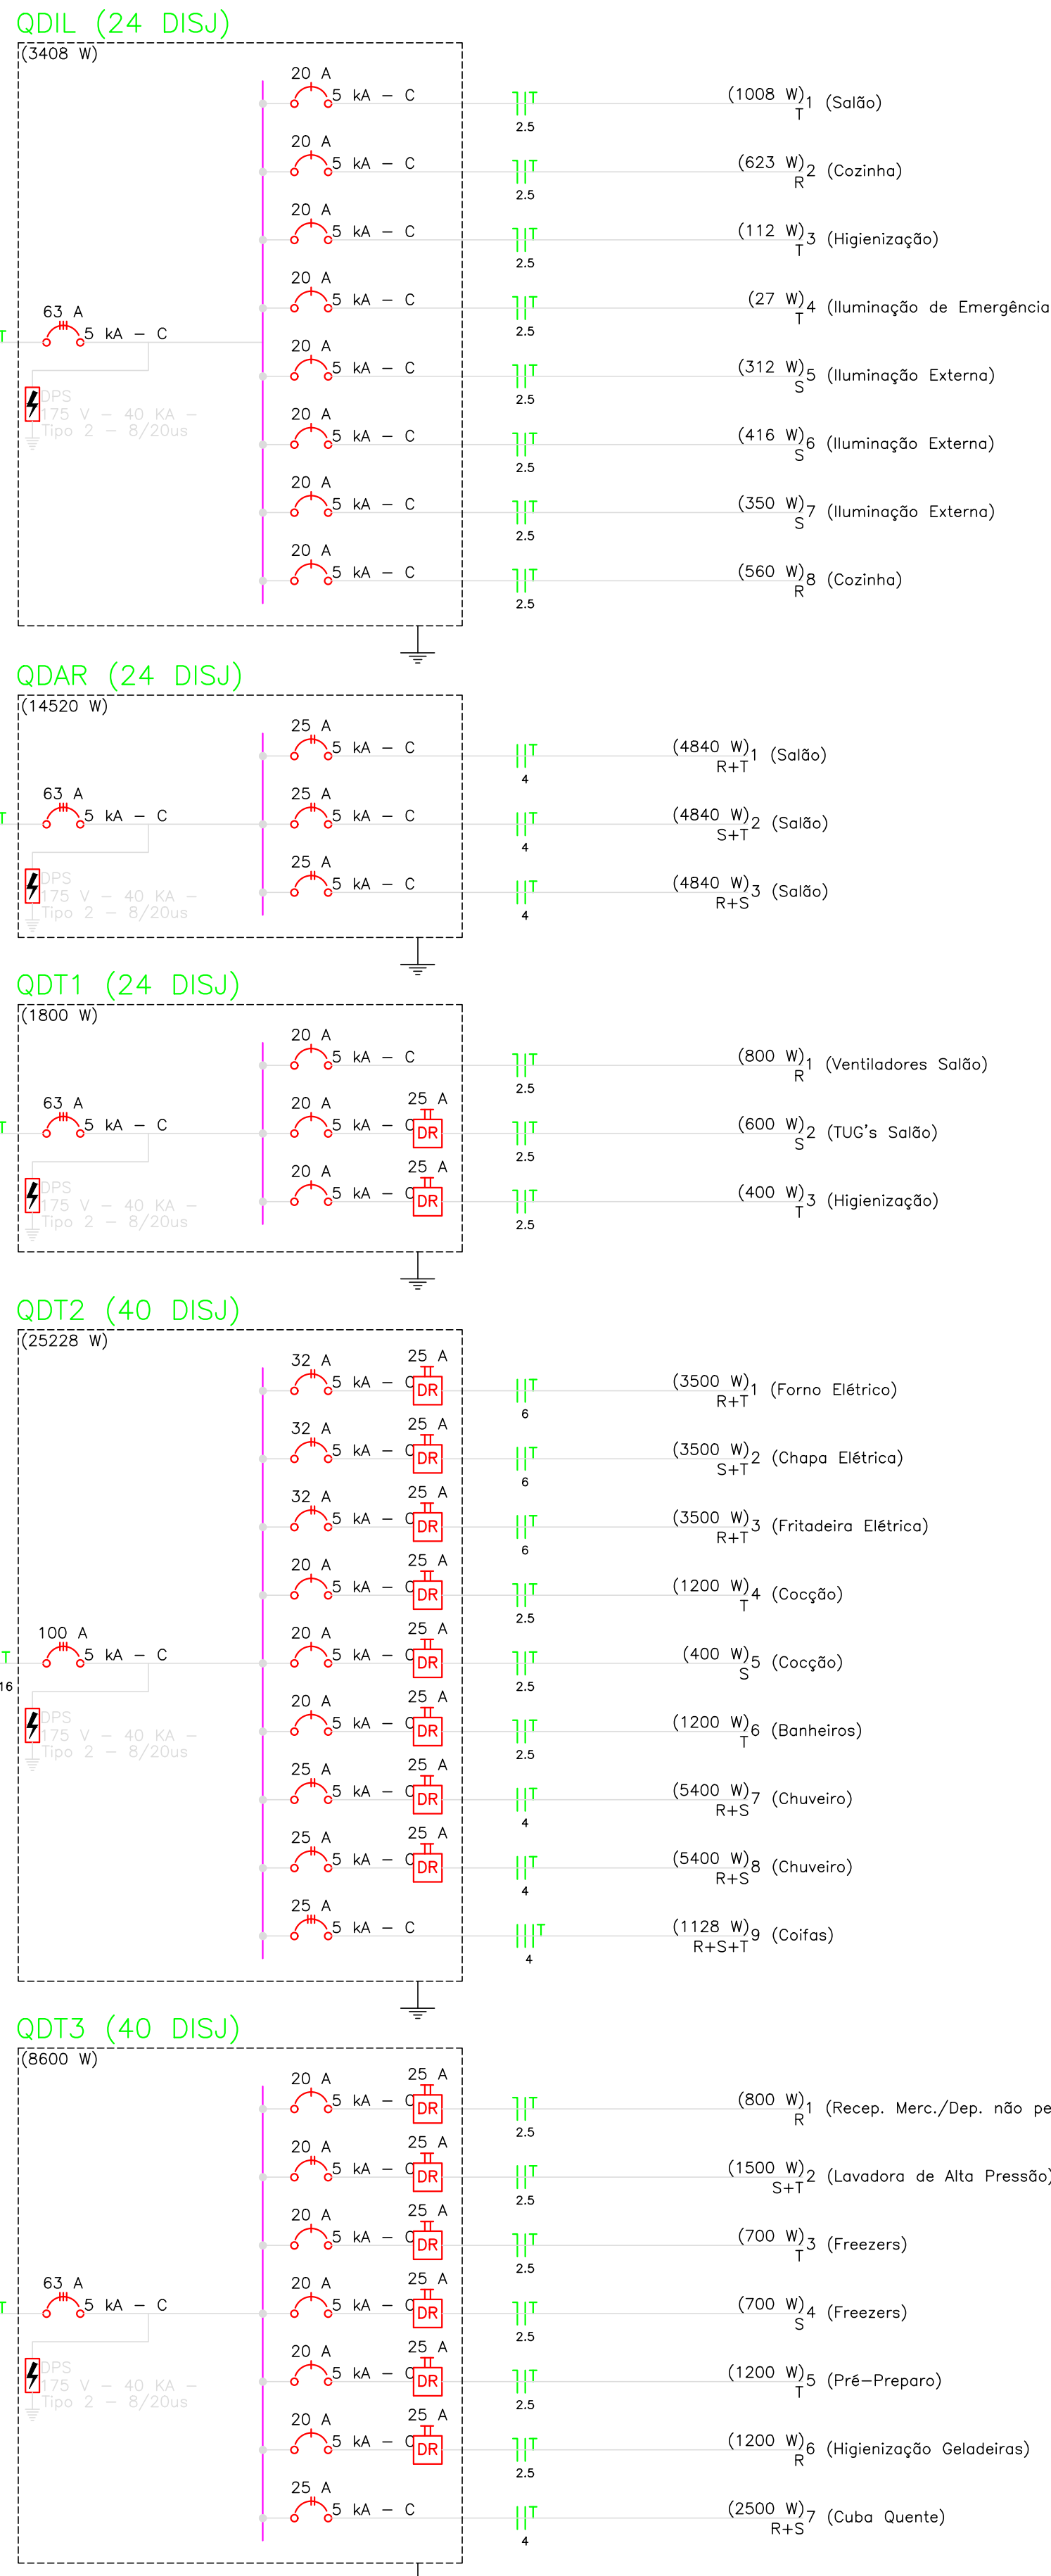



recinto	Descrição	Esquema	Método de inst.	V (V)	Pot. total (VA)	Pot. total (W)	Fases	Pot. - R (W)	Pot. - S (W)	Pot. - T (W)	FCt	FCA	In' (mm2)	Seção (mm2)	lc (m)
QDIL		3F+N+T	RI	220 / 127 V	4172	3408	R+S+T	1183	1078	1147	0,94	1,00	12,6	16	68,0
QD11		3F+N+T	RI	220 / 127 V	1967	1860	R+S+T	600	600	600	0,94	1,00	7,4	16	88,0
QD12		3F+N+T	RI	220 / 127 V	1517	1433	R+S+T	484	484	484	0,94	1,00	5,0	16	68,0
QD13		3F+N+T	RI	220 / 127 V	25664	25228	R+S+T	9276	7926	8026	0,94	1,00	89,6	35	110,0
QD14		3F+N+T	RI	220 / 127 V	9208	8600	R+S+T	3250	2700	2850	0,94	1,00	30,7	16	68,0
TOTAL					56.793	53.556	R+S+T	19349	17144	17063					

Descrição	Esquema	Método de inst.	V (V)	I (A)	Iluminação (W)	Pot. total, (VA)	Pot. total, (W)	Fosses	Pot. - R (W)	Pot. - S (W)	Pot. - T (W)	FCt	FCA	I ² (A)
F+N+T	B1	127 V	1	3	23	26	1159	1008			1008	0,94	1,00	1,00
				4	18	379	504	R			504	1,00	1,00	1,00
				8	18	579	504	T			504	1,00	1,00	1,00
ha	F+N+T	B1	127 V	1	8	14	706	623	R	623		0,94	1,00	5,9
						6	193	168	R	168			1,00	1,6
						6	193	168	R	168			1,00	1,6

Descrição	Esquema	Método de inst.	V	Tomadas (W)	Pot. total, (W)	Fases	Pot. - R (W)	Pot. - S (W)	Pot. - T (W)	FC	FCA	In ²	Seção (mm ²)
				100	300								
Ventiladores Salão	F+N+T	B1	127	8	869	800	R			0,94	1,00	7,4	2,5
TUG's Salão	F+N+T	B1	127	3	633	600	S		600	0,94	1,00	5,3	2,5
Higienização	F+N+T	B1	127	4	444	400	R+S+T		400	0,94	1,00	3,7	2,5
				15	1967	1800		800	600	400			

inscrição	Esquema	Método de med.	Quando de Cargas (QDT) 40 DISU							Fases	Pot. (W)	S	Pot. (W)	FCT
			V	Tensões (V)					Pot. total.					
			100	350	600	1500	2500							
pressão	F+R+T	B1	127	V				800	800	R	800		0,94	
	F+R+T	B1	220	V				1.630	1500	S+T		750	0,94	
	F+R+T	B1	127	V	2			761	700	T			0,94	
	F+R+T	B1	127	V		2		761	700		700		0,94	
	F+R+T	B1	127	V		2		1.333	1200	T		1200	0,94	
deleitos	F+R+T	B1	127	V	2			1.333	1200	T	1200		0,94	
	F+R+T	B1	220	V				2500	2500	R+S	1250	1250	0,94	
	F+R+T	B1	220	V	4	4	1	9208	8600	R+S+T	2600	2600	0,94	

**OBSERVAÇÕES**

- [illegible]